



Tacoma Facility

1427 E 26th Street

Tacoma, WA 98421

(253) 272-7788


Quincy Facility

1302 NE Intermodal Way

Quincy, WA 98848

(509) 497-0350

REPAIR COUPLINGS

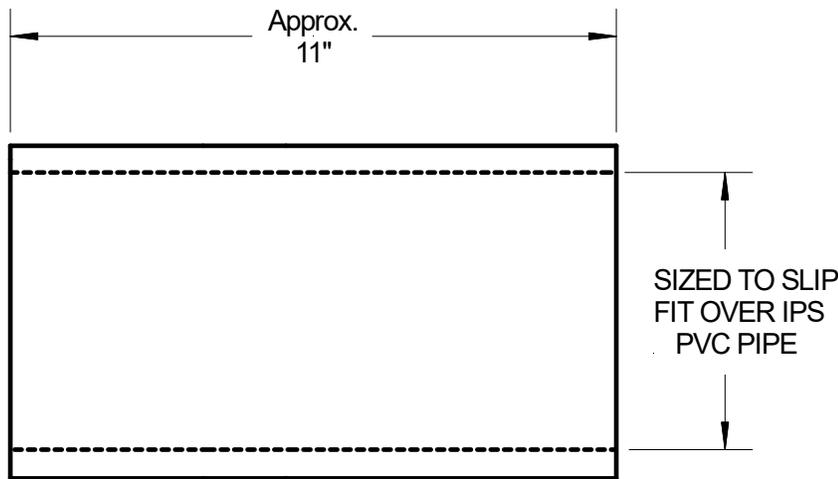

Pipe Size (inches)	C-duct Availability	DB 120 Availability	Schedule 40 Availability	Schedule 40 Weight (lbs)
1	No		Yes	0.324
1 ¼	No	No	Yes	0.456
1 ½	No		Yes	0.552
2	No	Yes	Yes	0.732
2 ½	No	No	Yes	1.164
3	No	Yes	Yes	1.656
3 ½	No	No	Yes	1.992
4	Yes	Yes	Yes	2.364
5	No		Yes	3.204
6	No	Yes	Yes	4.152

Advantages & Highlights of Repair Couplings

- Schedule 40 pipe is manufactured from pipe conforming to UL 651 and NEMA TC-2 *Electrical Polyvinyl Chloride (PVC) Conduit*
- Compression-Formed Straight Coupling without a center stop is conforming to NEMA TC-3 Socket Entrance Diameter requirements.
- DB120 is manufactured from pipe conforming to ASTM F512 *Smooth-Wall Poly(Vinyl Chloride) (PVC) Conduit and Fittings for Underground Installation*
- Couplings are intended to be joined with a cement that is or contains a solvent for polyvinyl chloride
- Weights are calculated for the nominal length of Schedule 40 pipe at 11" overall length
- Repair Coupling lengths are approximate and are bumped (edges made flat) for the following lengths:
 - 11"
 - 8"
 - 6"
 - Other custom upon request